

WATER FACILITIES: -
 Owned by Morrilton Water Works Co. Gravity System -
 Direct pressure in case of fire - Pumping Station located
 1 Mile S. of P.O. Water supply from Arkansas River -
 2 Smith-Rule P.M. size 10" x 6" x 8" capacity 400 gals. per
 hour - Stand pipe capacity 2000 gals. located on town
 level and above Railway Ave. Domestic pressure 65 lbs.
 Fire pressure 100 lbs. - Average daily consumption 80,000 gals.
 3/4" pipes of 15' & 8' mains. and 100' - 40 double hydrants -

FIRE DEPT: -
 Not Organized - 2 - 2 wheel jumpers with 300' 2" hose ea -
 1 H. & L. Truck, 3 Ladders - 16', 20' & 35' - to have 500 more new
 2 1/2" hose, 200' 2 1/2" - Alarm by Bell & Whistles -
 1000' ladders as shown -
 Streets not paved - Grades - Easy - Public Lights - Elec.




Map of Morrilton, Arkansas, 1913
 Library of Congress


INDEX

STREETS	NUMBER	NUMBER	NUMBER
Cherokee, O	100-303	7	Fire Department, F
Church, E., near Morrilton High School	100-405	7	First Baptist Church, B
Clifton, O	100-303	7	Methodist Episcopal Church (South), M
Clay, O	100-303	7	Independent Gin Co., I
Clayton, O	100-303	7	Morrilton Bottling Works, M
Crook, O	100-303	7	Olson Oil Co., O
Division, N	100-303	7	Parsons Printing, P
East, O	100-303	7	Phantoms' Ice Factory, P
Elm, E	100-303	7	Post Office, P
Flotoher, F	100-303	7	St. Agnes Episcopal Church, S
Griffin, S	100-303	7	St. Joseph, S
Hamble, H	100-303	7	Union Baptist Church, U
Howards, H	100-303	7	Wesley M. E. Church (Negro), W
May, M	100-303	7	
Moore, N	100-303	7	

W. RAILWAY AV.

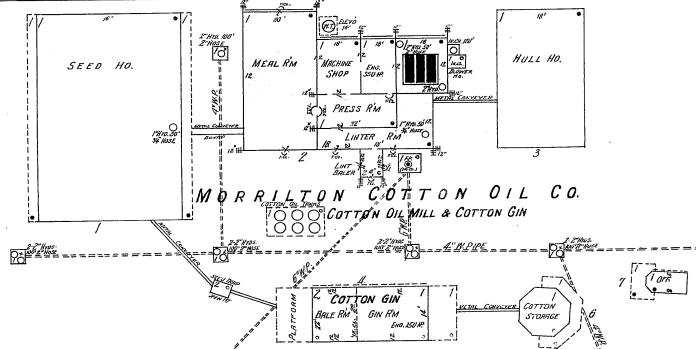

Scale of Feet. 0 50 100 150

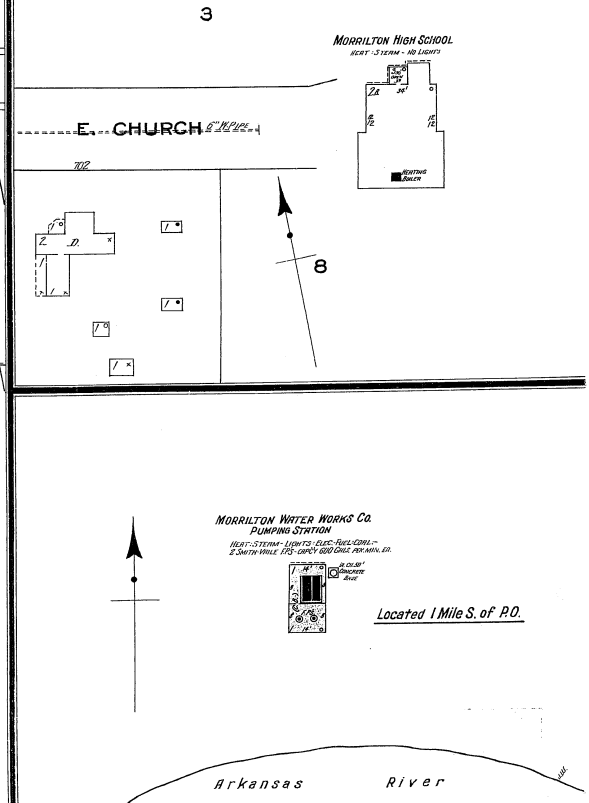

Located 1 Mile S. of P.O.